

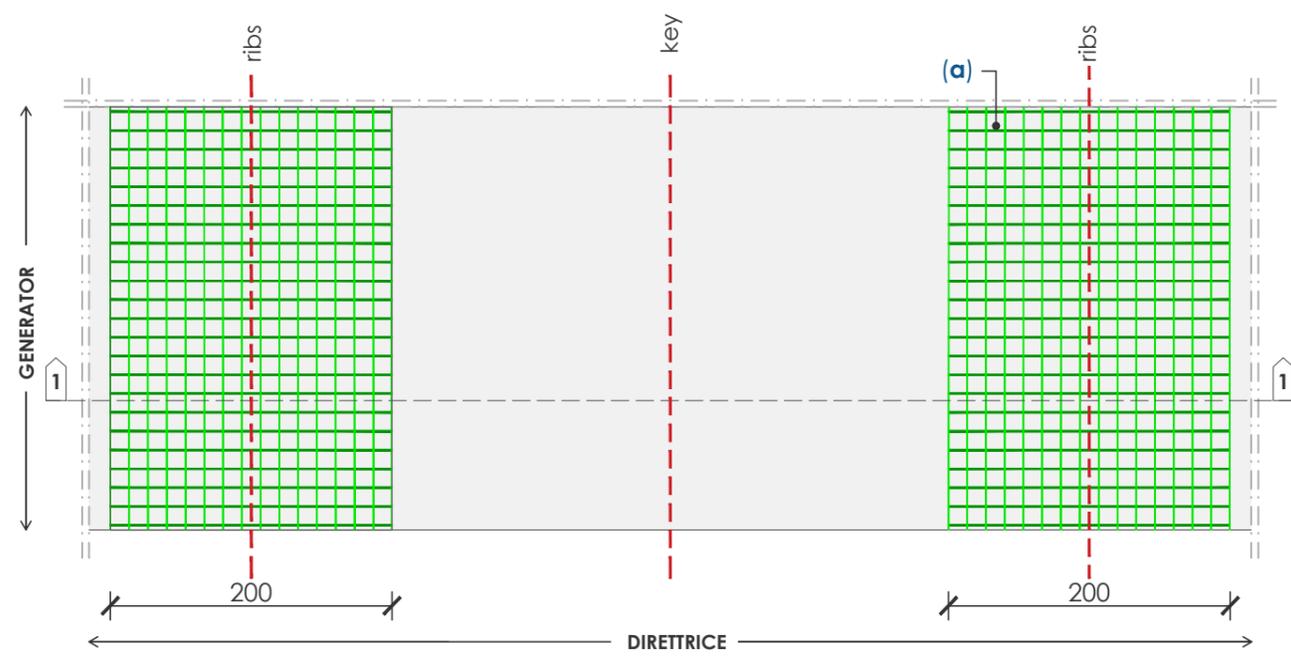


PHASE 1 - Installation of the mesh in critical areas (scale 1:50)

DEVELOPMENT OF THE EXTRADOS

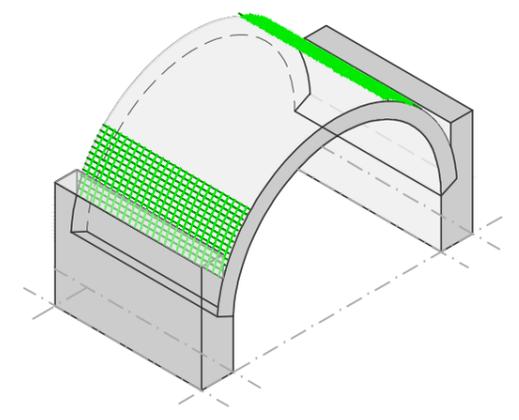

SECTION 1-1

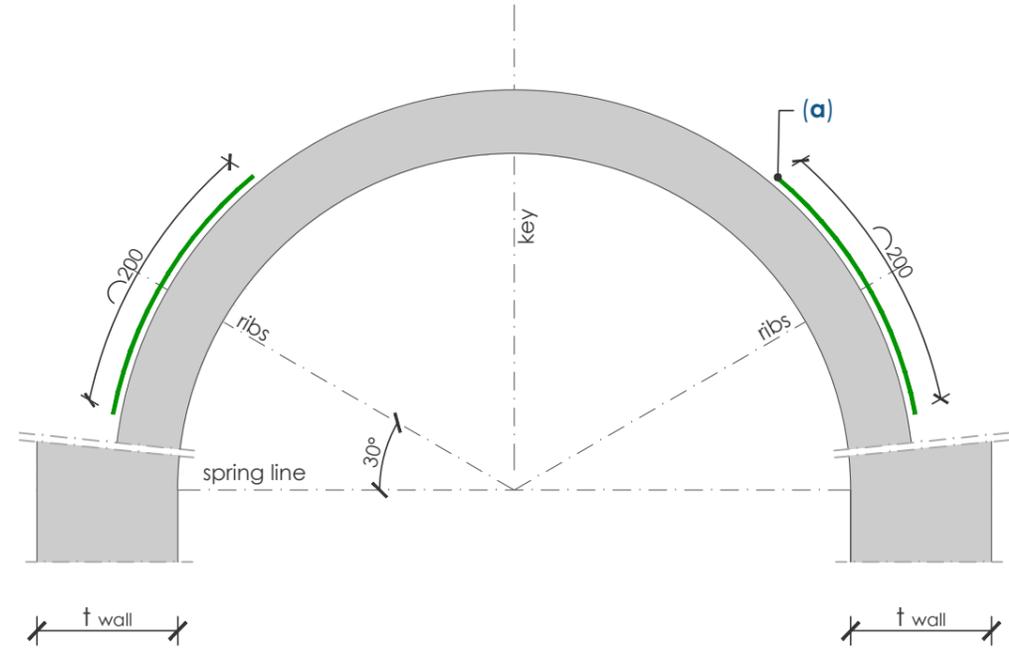


PHASE 1:
Preparation of the surface by removing existing finishing layers and possible reconstruction of damaged parts.
Subsequent application of undercoat to the extrados of the vault.
Installation of GFRP mesh with a width of 200 cm to the extrados of the vault, aligned with the ribs of the vault, as indicated. The netting must be placed along the middle plane of the plaster.



NOTE:
Avoid interrupting the continuity of the mesh in the indicated critical areas.

PHASE 2 - Installation of the mesh in the remaining areas with continuity overlap (scale 1:50)

DEVELOPMENT OF THE EXTRADOS

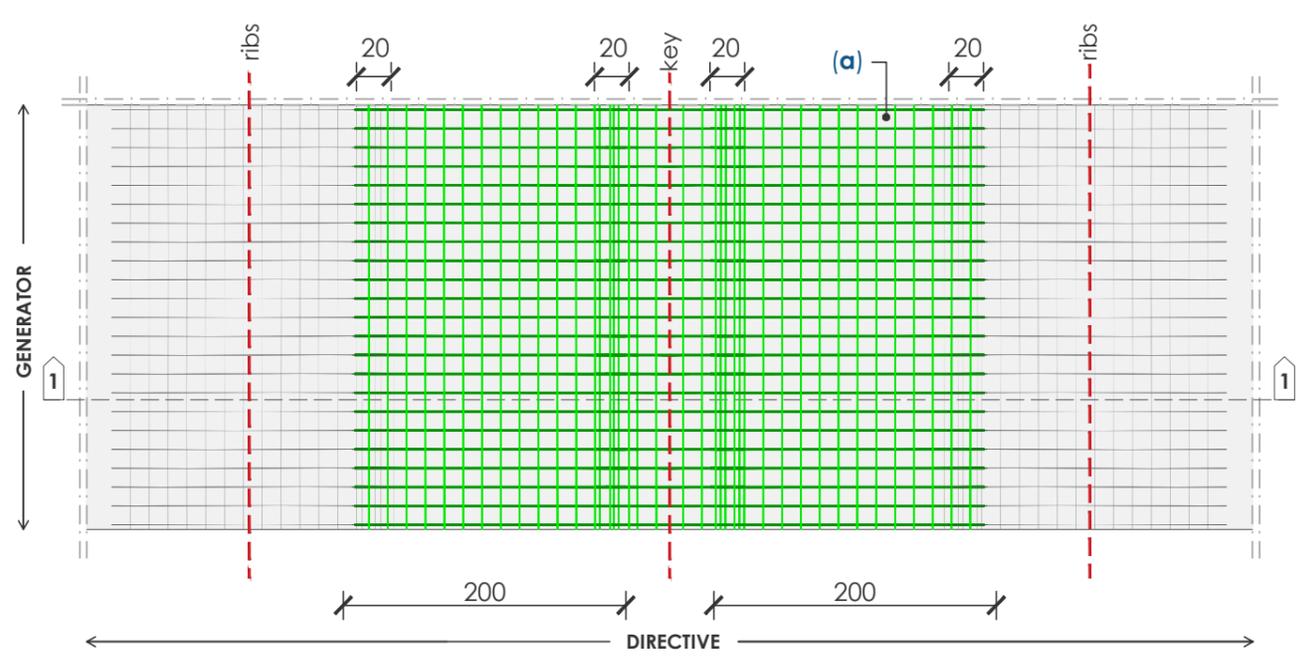

SECTION 1-1

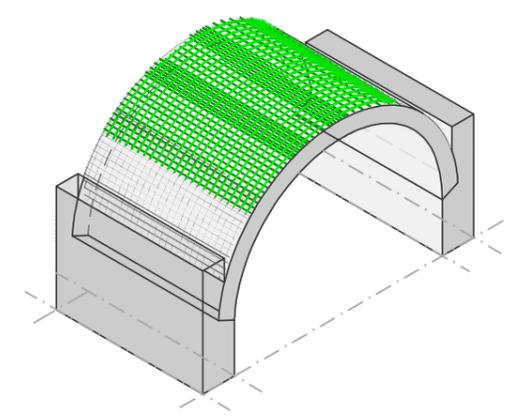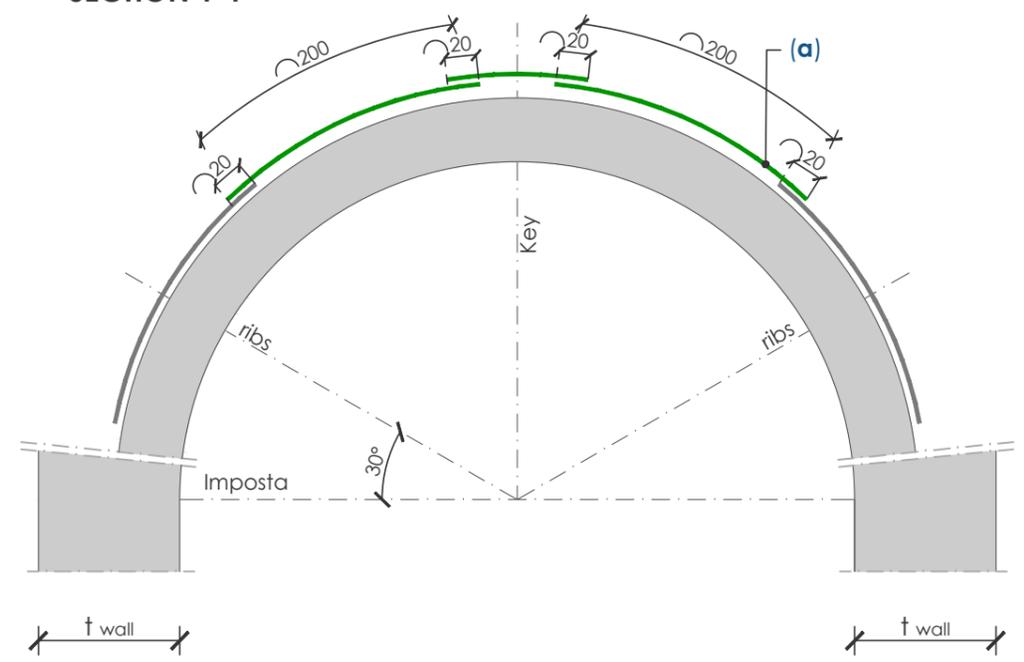

PHASE 2:
Completion of laying GFRP mesh along the middle plane of the plaster in the remaining areas of the extrados of the vault with an overlap of at least 20cm compared to the sections already laid in PHASE 1.

The measurements are expressed in centimeters unless otherwise specified
For the layout diagram of connectors and materials table, please refer to table CRM19